


Analiza visokih vod - Log Pearson

Podatki v racunu :

1955	30.20	1956	23.50	1957	25.50	1958	72.20
1959	69.80	1960	63.90	1961	63.90	1962	49.70
1963	46.20	1964	58.00	1965	75.80	1966	70.40
1967	52.30	1968	38.60	1969	34.40	1970	29.60
1971	20.60	1972	39.50	1973	44.83	1974	32.30
1975	54.50	1976	31.08	1977	54.31	1978	22.30
1979	42.15	1980	40.51	1981	14.04	1982	56.34
1983	32.52	1984	32.52	1985	28.86	1986	31.08
1987	38.24	1988	23.72	1989	40.20	1990	46.50
1991	21.80	1992	41.10	1993	32.80	1994	19.66
1995	25.00	1996	46.70	1997	29.51	1998	35.00
1999	10.25	2000	52.30	2005	29.12	2006	39.95
2007	109.90	2011	38.88	2012	58.06		

Srednja vrednost pretokov Qsr= 41.57 LOG Qsr= 3.6340
St. deviacija za LOG S= 0.446063 KOEF Cv= 0.12154
Koef. asimetrije za LOG Psi= -0.34794 KOEF Cs=-0.33762
Koeficient skladanja po Gringortenu = 0.9266541

Pov. doba	5%conf. limit	pretok	95%conf. limit
2.00	0.00	38.85	0.00
2.50	49.51	43.40	38.33
5.00	63.38	55.42	49.49
10.00	76.63	65.78	58.24
20.00	89.27	75.26	65.92
25.00	93.24	78.18	68.24
40.00	101.48	84.15	72.94
50.00	105.34	86.91	75.10
100.00	117.15	95.25	81.52
200.00	128.71	103.27	87.60
500.00	143.69	113.46	95.23
1000.00	154.83	120.93	100.74
2000.00	165.83	128.20	106.05
5000.00	179.72	137.30	112.67
10000.00	190.72	144.37	117.72

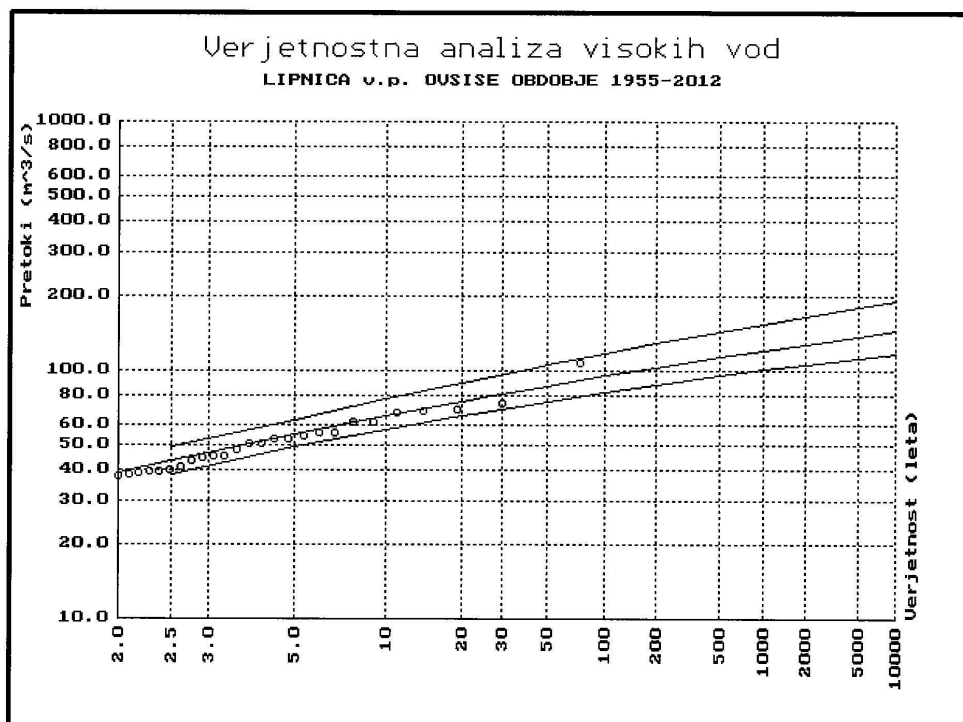


Analiza visokih vod - Log Pearson

Podatki v racunu :

1955	30.20	1956	23.50	1957	25.50	1958	72.20
1959	69.80	1960	63.90	1961	63.90	1962	49.70
1963	46.20	1964	58.00	1965	75.80	1966	70.40
1967	52.30	1968	38.60	1969	34.40	1970	29.60
1971	20.60	1972	39.50	1973	44.83	1974	32.30
1975	54.50	1976	31.08	1977	54.31	1978	22.30
1979	42.15	1980	40.51	1981	14.04	1982	56.34
1983	32.52	1984	32.52	1985	28.86	1986	31.08
1987	38.24	1988	23.72	1989	40.20	1990	46.50
1991	21.80	1992	41.10	1993	32.80	1994	19.66
1995	25.00	1996	46.70	1997	29.51	1998	35.00
1999	10.25	2000	52.30	2005	29.12	2006	39.95
2007	109.90						

Srednja vrednost pretokov Qsr= 41.29 LOG Qsr= 3.6247
St. deviacija za LOG S= 0.450946 KOEF Cv= 0.12313
Koef. asimetrije za LOG Psi= -0.30561 KOEF Cs=-0.29617
Koeficient skladanja po Gringortenu = 0.9564182

Pov. doba	5%conf. limit	pretok	95%conf. limit
2.00	0.00	38.38	0.00
2.50	49.07	42.94	37.88
5.00	63.30	55.11	49.06
10.00	77.05	65.75	57.96
20.00	90.33	75.58	65.87
25.00	94.53	78.63	68.27
40.00	103.31	84.91	73.17
50.00	107.44	87.82	75.42
100.00	120.19	96.70	82.18
200.00	132.82	105.31	88.64
500.00	149.38	116.38	96.83
1000.00	161.66	124.46	102.72
2000.00	174.18	132.57	108.56
5000.00	190.47	143.01	116.04
10000.00	202.81	150.78	121.50

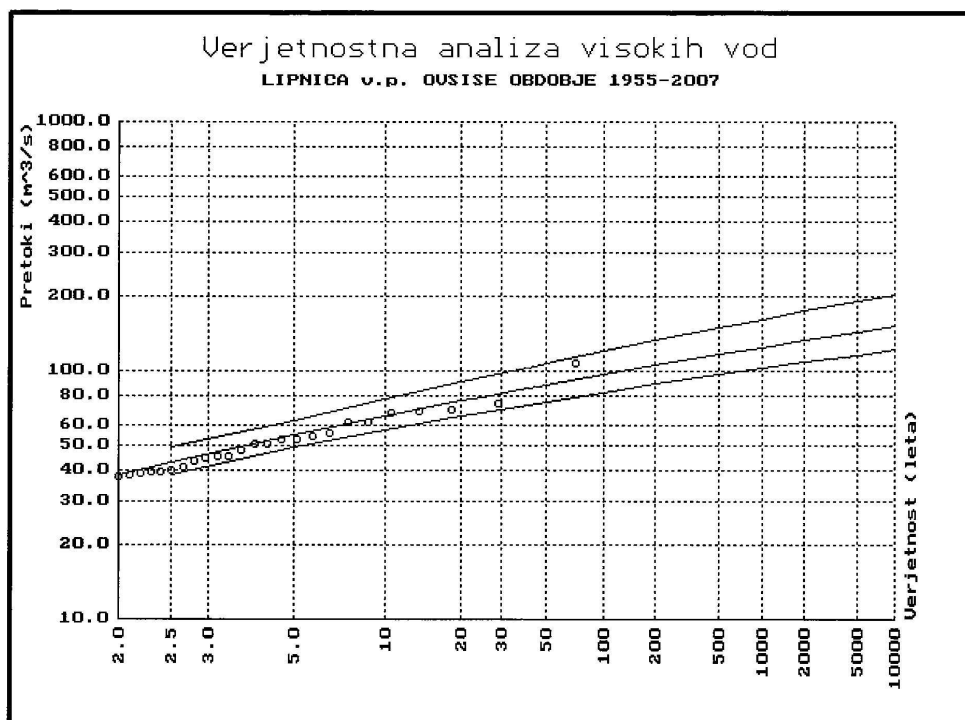

Analiza visokih vod - Log Pearson

Podatki v racunu :

1955	30.20	1956	23.50	1957	25.50	1958	72.20
1959	69.80	1960	63.90	1961	63.90	1962	49.70
1963	46.20	1964	58.00	1965	75.80	1966	70.40
1967	52.30	1968	38.60	1969	34.40	1970	29.60
1971	20.60	1972	39.50	1973	44.83	1974	32.30
1975	54.50	1976	31.08	1977	54.31	1978	22.30
1979	42.15	1980	40.51	1981	14.04	1982	56.34
1983	32.52	1984	32.52	1985	28.86	1986	31.08
1987	38.24	1988	23.72	1989	40.20	1990	46.50
1991	21.80	1992	41.10	1993	32.80	1994	19.66
1995	25.00	1996	46.70	1997	29.51	1998	35.00
1999	10.25	2000	52.30	2005	29.12	2006	39.95

Srednja vrednost pretokov Qsr= 39.86 LOG Qsr= 3.6023
 St. deviacija za LOG S= 0.427299 KOEF Cv= 0.11738
 Koef. asimetrije za LOG Psi= -0.55637 KOEF Cs=-0.53883
 Koeficient skladanja po Gringortenu = 0.9167996

Pov. doba	5%conf. limit	pretok	95%conf. limit
2.00	0.00	38.16	0.00
2.50	48.86	42.34	37.01
5.00	60.42	52.88	47.29
10.00	71.15	61.40	54.63
20.00	80.85	68.77	60.71
25.00	83.82	70.98	62.51
40.00	89.76	75.35	66.01
50.00	92.47	77.32	67.58
100.00	100.45	83.06	72.09
200.00	107.88	88.32	76.17
500.00	116.96	94.65	81.03
1000.00	123.30	99.03	84.34
2000.00	129.32	103.13	87.44
5000.00	136.66	108.11	91.17
10000.00	141.90	111.61	93.76

