


Analiza visokih vod - Log Pearson

Podatki v racunu :

1964	3.64	1965	5.68	1966	3.64	1967	2.96
1968	20.10	1979	7.57	1980	4.65	1981	1.85
1983	1.43	1984	4.20	1986	1.73	1987	5.34
1988	2.39	1989	9.44	1990	17.80	1991	17.50
1992	3.19	1993	3.12	1994	2.51	1995	1.86
1996	3.24	2000	2.14	2001	2.15	2002	2.01
2003	1.33	2004	3.27	2005	3.16	2006	2.14
2007	3.98	2008	3.27	2009	3.27	2010	3.26
2011	3.23	2012	3.99				

Srednja vrednost pretokov Qsr= 4.74 LOG Qsr= 1.2812
 St. deviacija za LOG S= 0.670244 KOEF Cv= 0.51539
 Koef. asimetrije za LOG Psi= 1.18611 KOEF Cs= 1.13313
 Koeficient skladanja po Gringortenu = 0.8573214

Pov. doba	5%conf. limit	pretok	95%conf. limit
2.00	0.00	3.16	0.00
2.50	3.59	3.74	3.91
5.00	4.94	5.89	7.33
10.00	6.97	8.84	12.12
20.00	9.62	12.93	19.39
25.00	10.64	14.56	22.46
40.00	13.08	18.60	30.43
50.00	14.41	20.85	35.07
100.00	19.32	29.55	54.10
200.00	25.71	41.52	82.64
500.00	37.18	64.49	143.08
1000.00	48.81	89.24	214.61
2000.00	63.88	123.10	320.73
5000.00	90.62	186.87	539.93
10000.00	116.89	253.63	791.39

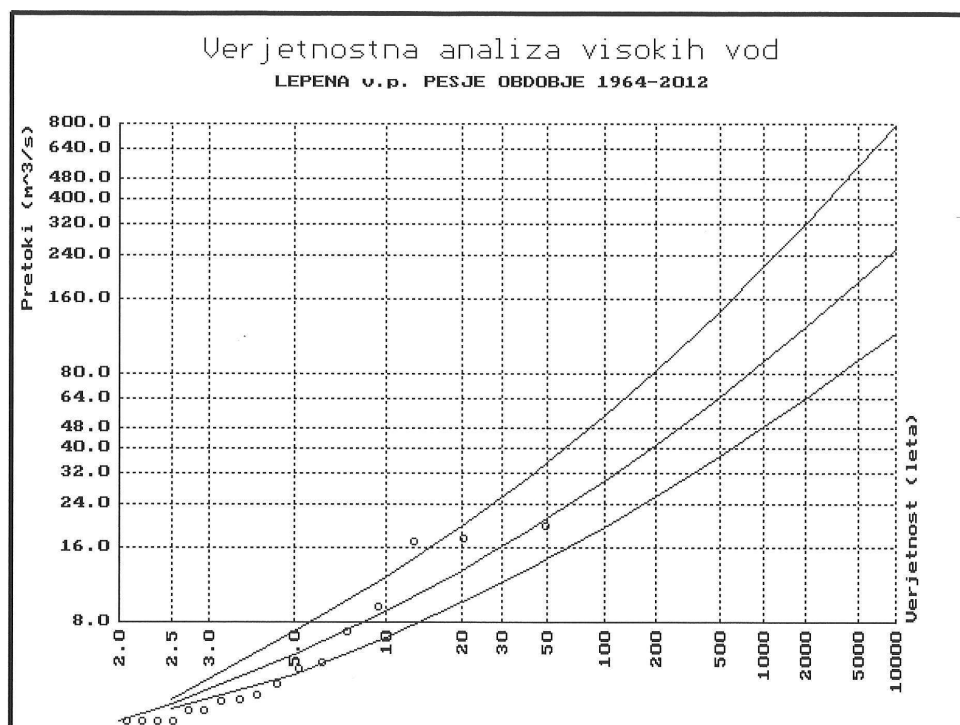


Analiza visokih vod - Log Pearson

Podatki v racunu :

1979	2.88	1980	2.24	1981	1.37	1982	1.55
1983	4.32	1984	4.32	1985	1.88	1986	2.01
1987	1.68	1988	1.25	1989	3.62	1990	3.48
1991	3.19	1992	1.55	1993	2.55	1994	1.57
1995	1.50	1996	3.01	1997	6.87	1998	9.02
1999	5.91	2000	1.16	2001	1.87	2002	1.11
2003	1.44	2004	4.36	2005	3.36	2006	2.10
2007	3.78	2008	1.05	2009	1.27	2010	7.95
2011	1.21	2012	1.41				

Srednja vrednost pretokov Qsr= 2.88 LOG Qsr= 0.8656
 St. deviacija za LOG S= 0.603388 KOEF Cv= 0.68672
 Koef. asimetrije za LOG Psi= 0.59165 KOEF Cs= 0.56522
 Koeficient skladanja po Gringortenu = 0.9257823

Pov. doba	5%conf. limit	pretok	95%conf. limit
2.00	0.00	2.24	0.00
2.50	2.35	2.61	2.92
5.00	3.24	3.85	4.77
10.00	4.28	5.30	7.02
20.00	5.46	7.02	9.89
25.00	5.88	7.65	10.99
40.00	6.82	9.09	13.59
50.00	7.30	9.84	14.99
100.00	8.93	12.48	20.11
200.00	10.82	15.66	26.62
500.00	13.77	20.84	37.97
1000.00	16.41	25.66	49.18
2000.00	19.45	31.42	63.27
5000.00	24.17	40.67	87.23
10000.00	28.38	49.29	110.90

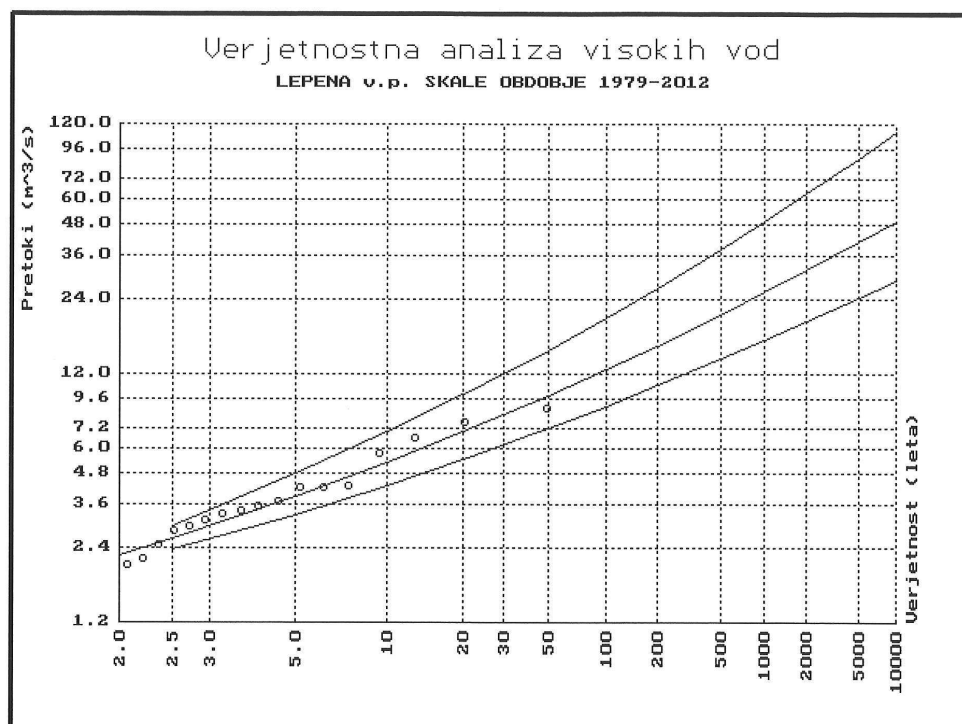


Analiza visokih vod - Log Pearson

Podatki v racunu :

1979	3.75	1980	4.41	1981	3.11	1982	3.11
1983	5.84	1984	2.01	1985	3.13	1986	2.38
1987	2.66	1988	2.73	1989	2.61	1990	4.79
1991	2.22	1992	1.95	1993	2.54	1994	1.83
1995	1.92	1996	2.38	1997	3.87	1998	11.78
1999	6.88	2000	2.04	2001	3.82	2002	1.52
2003	0.94	2004	4.42	2005	5.07	2006	3.77
2007	5.98	2008	3.31	2009	2.94	2010	3.68
2011	1.28	2012	7.89				

Srednja vrednost pretokov Qsr= 3.60 LOG Qsr= 1.1427
St. deviacija za LOG S= 0.526716 KOEF Cv= 0.45412
Koef. asimetrije za LOG Psi= 0.20194 KOEF Cs= 0.19292
Koeficient skladanja po Gringortenu = 0.9168223

Pov. doba	5%conf. limit	pretok	95%conf. limit
2.00	0.00	3.08	0.00
2.50	3.09	3.52	4.05
5.00	4.15	4.86	5.90
10.00	5.19	6.22	7.91
20.00	6.24	7.68	10.20
25.00	6.59	8.17	10.99
40.00	7.33	9.25	12.79
50.00	7.70	9.78	13.70
100.00	8.87	11.54	16.78
200.00	10.11	13.45	20.26
500.00	11.87	16.25	25.60
1000.00	13.30	18.58	30.23
2000.00	14.80	21.09	35.36
5000.00	16.96	24.77	43.16
10000.00	18.80	28.00	50.29

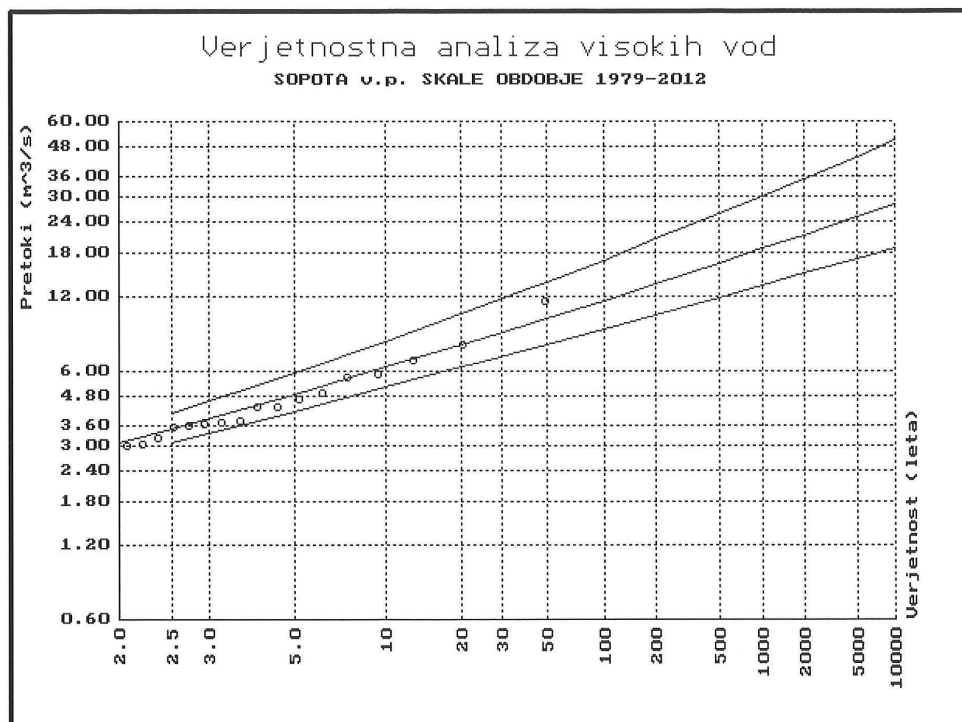


Analiza visokih vod - Log Pearson

Podatki v racunu :

1953	79.00	1954	127.00	1955	15.20	1956	87.50
1957	26.50	1964	31.00	1965	20.70	1966	42.30
1967	11.00	1968	23.30	1978	14.40	1979	15.60
1980	19.90	1981	21.30	1982	8.64	1983	11.80
1984	11.80	1985	15.30	1986	11.60	1987	20.30
1988	19.10	1989	17.00	1990	34.80	1991	8.80
1992	12.20	1993	8.55	1994	6.92	1995	14.79
1996	20.60	1997	40.20	1998	49.88	1999	13.16
2000	13.50	2001	8.87	2002	9.90	2003	5.57
2004	10.20	2005	12.77	2006	7.54	2007	17.71
2008	10.24	2009	12.82	2010	18.19	2011	7.33
2012	66.41						

Srednja vrednost pretokov Qsr= 23.58 LOG Qsr= 2.8600
 St. deviacija za LOG S= 0.708777 KOEF Cv= 0.24506
 Koef. asimetrije za LOG Psi= 1.00679 KOEF Cs= 0.97291
 Koeficient skladanja po Gringortenu = 0.9189540

Pov. doba	5%conf. limit	pretok	95%conf. limit
2.00	0.00	15.53	0.00
2.50	17.49	18.56	19.78
5.00	25.22	29.85	36.57
10.00	36.17	45.15	59.87
20.00	50.37	66.09	94.36
25.00	55.79	74.36	108.65
40.00	68.79	94.75	145.25
50.00	75.82	106.04	166.27
100.00	101.76	149.22	250.68
200.00	135.32	207.87	373.61
500.00	195.07	318.38	624.61
1000.00	255.23	435.73	912.07
2000.00	333.27	595.12	1329.02
5000.00	470.53	890.16	2160.48
10000.00	609.25	1205.25	3118.16

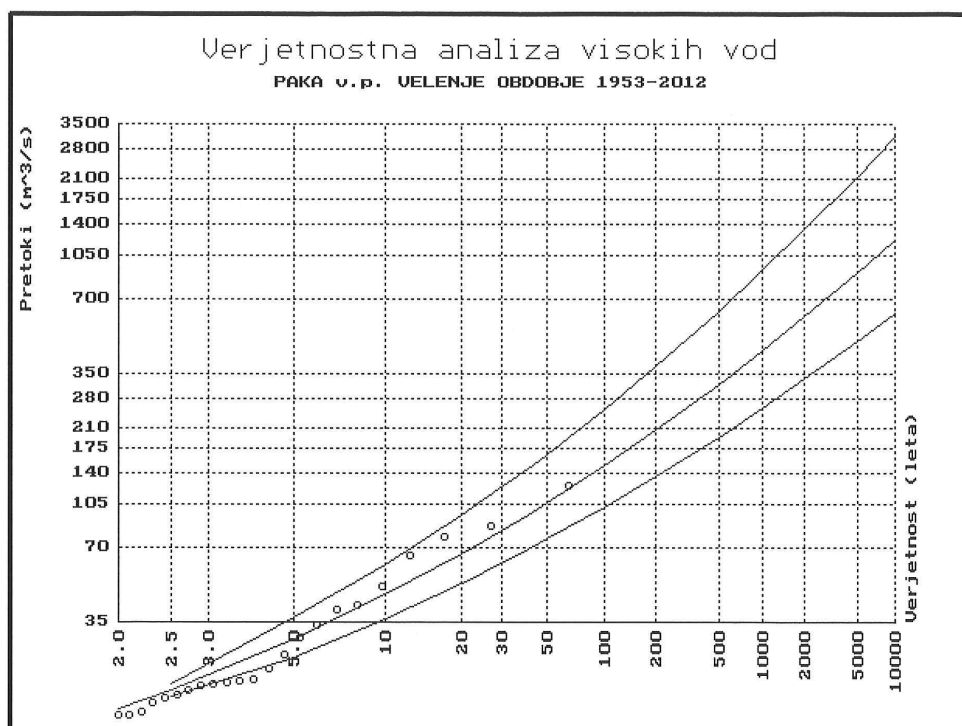


Analiza visokih vod - Log Pearson

Podatki v racunu :

1986	8.80	1987	13.20	1988	9.54	1989	13.70
1990	36.30	1991	11.90	1992	14.70	1993	20.10
1994	6.11	1995	74.07	1996	24.30	1997	6.55
1998	48.97	1999	12.63	2000	16.10	2001	13.86
2002	6.09	2003	10.66	2004	11.50	2005	14.37
2006	4.33	2007	14.43	2008	5.25	2009	4.52
2010	13.92	2011	3.55	2012	67.93		

Srednja vrednost pretokov Qsr= 18.05 LOG Qsr= 2.5595
 St. deviacija za LOG S= 0.784595 KOEF Cv= 0.30081
 Koef. asimetrije za LOG Psi= 0.60930 KOEF Cs= 0.57491
 Koeficient skladanja po Gringortenu = 0.8666430

Pov. doba	5%conf. limit	pretok	95%conf. limit
2.00	0.00	11.94	0.00
2.50	12.54	14.59	17.21
5.00	18.83	24.19	33.29
10.00	26.98	36.68	55.91
20.00	36.93	53.04	88.93
25.00	40.59	59.31	102.41
40.00	49.13	74.43	136.59
50.00	53.62	82.61	155.96
100.00	69.57	112.86	232.19
200.00	89.04	151.86	339.33
500.00	121.49	221.06	549.10
1000.00	152.16	290.33	779.21
2000.00	189.05	377.79	1093.07
5000.00	251.95	535.30	1710.72
10000.00	309.37	687.76	2363.95

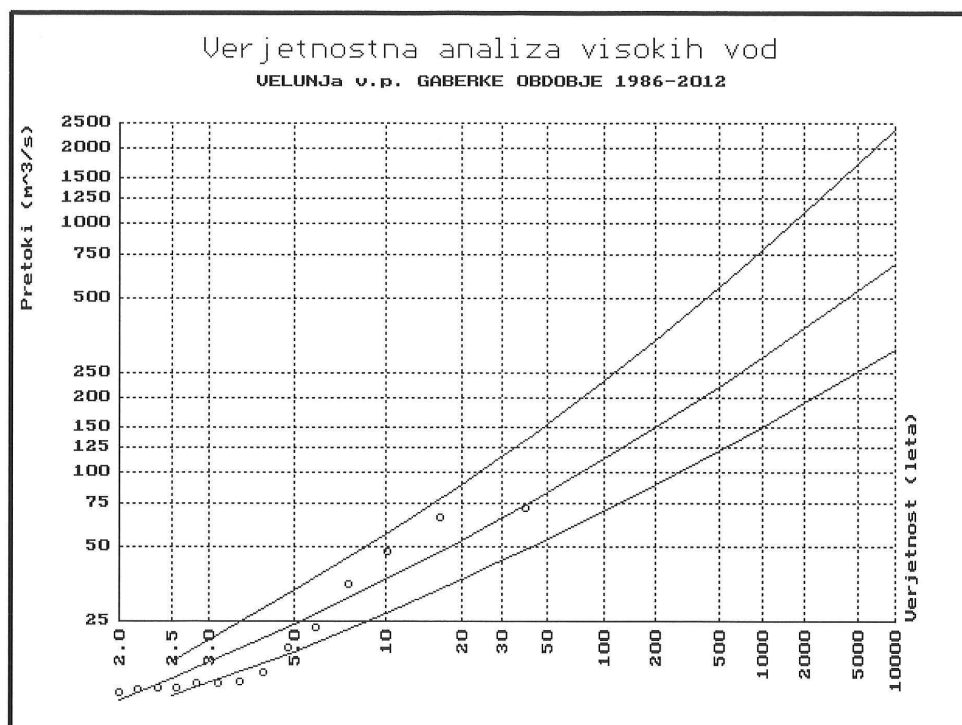


Analiza visokih vod - Log Pearson

Podatki v racunu :

1956	9.37	1957	10.10	1958	17.50	1959	12.80
1960	9.52	1961	25.00	1962	11.90	1963	15.20
1964	20.90	1965	13.90	1966	20.40	1967	7.52
1968	7.90	1969	15.20	1970	11.10	1971	5.53
1972	16.60	1973	21.90	1974	13.00	1975	19.40
1976	15.40	1977	13.20	1978	7.13	1979	27.50
1980	22.30	1981	3.75	1982	8.78	1983	4.28
1984	5.97	1985	3.89	1986	3.90	1987	8.64
1988	3.89	1989	6.55	1990	15.30	1991	5.40
1992	6.04	1993	4.71	1994	1.59	1995	3.19
1996	3.56	1997	2.20	1998	8.18	1999	2.88
2000	3.06	2001	2.38	2002	1.16	2003	0.88
2004	3.04	2005	6.15	2006	1.44	2007	1.19
2008	2.05	2009	0.98	2010	1.77	2011	0.55
2012	1.57						

Srednja vrednost pretokov Qsr= 8.76 LOG Qsr= 1.7789
St. deviacija za LOG S= 0.978995 KOEF Cv= 0.54549
Koef. asimetrije za LOG Psi= -0.45198 KOEF Cs=-0.44000
Koeficient skladanja po Gringortenu = 0.9195248

Pov. doba	5%conf. limit	pretok	95%conf. limit
2.00	0.00	6.38	0.00
2.50	10.80	8.11	6.19
5.00	18.07	13.69	10.81
10.00	26.76	19.62	15.27
20.00	36.51	25.89	19.76
25.00	39.84	27.98	21.22
40.00	47.19	32.47	24.31
50.00	50.81	34.65	25.79
100.00	62.60	41.58	30.41
200.00	75.14	48.73	35.08
500.00	92.72	58.47	41.29
1000.00	106.70	66.01	46.01
2000.00	121.04	73.60	50.69
5000.00	140.86	83.89	56.96
10000.00	156.05	91.59	61.55

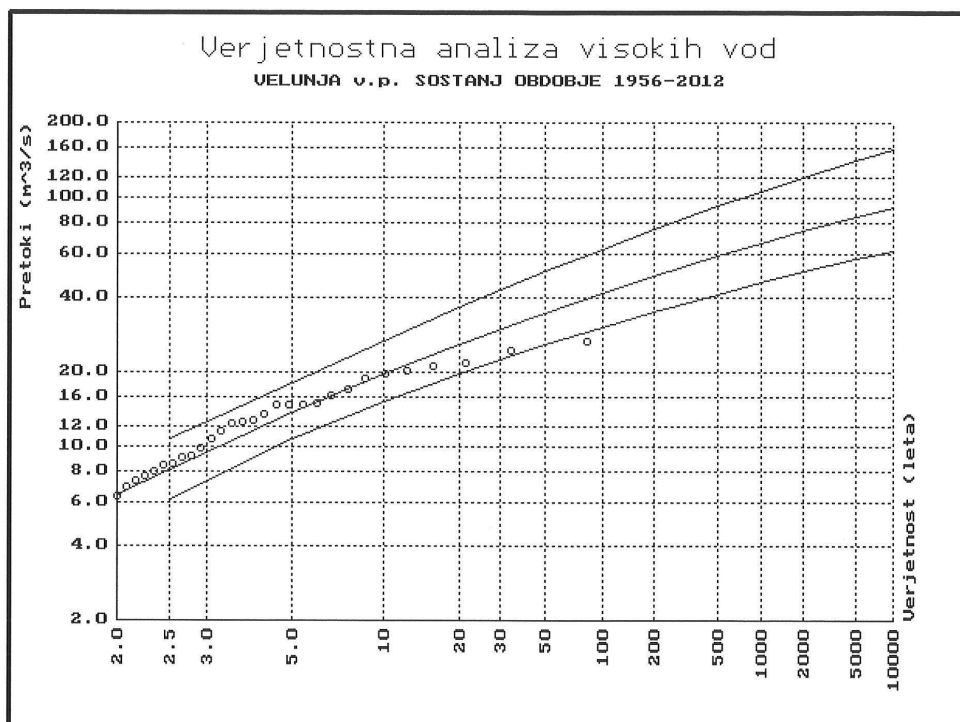

Analiza visokih vod - Log Pearson

Podatki v racunu :

1959	24.80	1960	46.20	1961	84.00	1962	47.00
1963	15.30	1964	25.80	1965	37.90	1966	38.80
1967	33.40	1968	22.00	1969	29.30	1970	38.00
1971	7.24	1972	25.20	1973	26.60	1974	19.20
1975	52.10	1976	33.80	1977	38.00	1978	25.10
1979	47.10	1980	86.30	1981	46.30	1982	58.80
1983	39.80	1984	33.40	1985	22.60	1986	65.60
1987	30.80	1988	36.80	1989	31.10	1990	75.50
1991	65.50	1992	63.80	1993	67.10	1994	20.14
1995	20.14	1996	38.61	1997	53.25	1998	32.31
1999	25.17	2000	148.00	2001	11.94	2002	24.23
2003	50.79	2004	23.44	2005	19.41	2006	25.15
2007	25.35	2008	25.94	2009	50.79	2010	35.58
2011	19.10	2012	50.41				

Srednja vrednost pretokov Qsr= 39.63 LOG Qsr= 3.5402
 St. deviacija za LOG S= 0.530547 KOEF Cv= 0.14847
 Koef. asimetrije za LOG Psi= -0.03347 KOEF Cs=-0.03253
 Koeficient skladanja po Gringortenu = 0.9022578

Pov. doba	5%conf. limit	pretok	95%conf. limit
2.00	0.00	34.58	0.00
2.50	44.96	39.54	35.02
5.00	62.82	53.92	47.38
10.00	81.40	67.91	58.70
20.00	101.11	82.09	69.73
25.00	107.73	86.73	73.28
40.00	122.17	96.70	80.78
50.00	129.26	101.52	84.36
100.00	152.34	116.90	95.63
200.00	177.06	132.97	107.16
500.00	212.32	155.26	122.84
1000.00	241.19	173.07	135.13
2000.00	272.18	191.81	147.87
5000.00	315.03	217.22	164.93
10000.00	351.81	238.50	178.90

